


HYDRANTS AND MAINS CAPACITY DATA SHEET

Mains Capacity at 100 kpa running pressure

Issue Date:

Monday, 17 January 2000

Location	No	Date	Size	Sp	Rp	Flow	Main Cap l/s
ANZAC AV CNR AWATEA S		/12/91	150	720	500	31	55
ANZAC AV EAST OF ALBAN		/01/93	150	750	530	44	80
ANZAC AVO/S REHAB; LEA		/12/91	150	525	375	40	74
FRYATT ST CNR OIL WHAR		/09/82	150	530	380	50	93
FRYATT ST SOUTH OIL WH		/01/93	150	550	425	38	78
LEANDER STREET CNR AW		/01/93	150	700	450	50	83
LIQUIGAS DEPOT		/01/93	375	650	625	51	258
MINERVA ST (END OF)		/12/91	225	625	325	44	62
MINERVA ST O/S PLACEMA		/01/93	150	710	475	45	77
OTAGO YACHT CLUB		/01/93	100	700	550	34	72
PARRY STREET CNR MINE		/12/91	150	525	250	38	52
PARRY ST O/S R.S.A. BOWLI		/01/93	150	700	500	38	70
RAVENSBOURNE ROAD CN		/01/93	150	750	500	44	75
RAVENSBOURNE RD O/S W		/01/86	150	800	550	50	88
RIEGO STREET		/01/93	100	800	625	40	84
WICKLIFFE ST CNR FRYATT		/12/91	150	640	400	27	43
WICKLIFFE ST CNR JUTLAN		/01/93	150	600	350	41	62

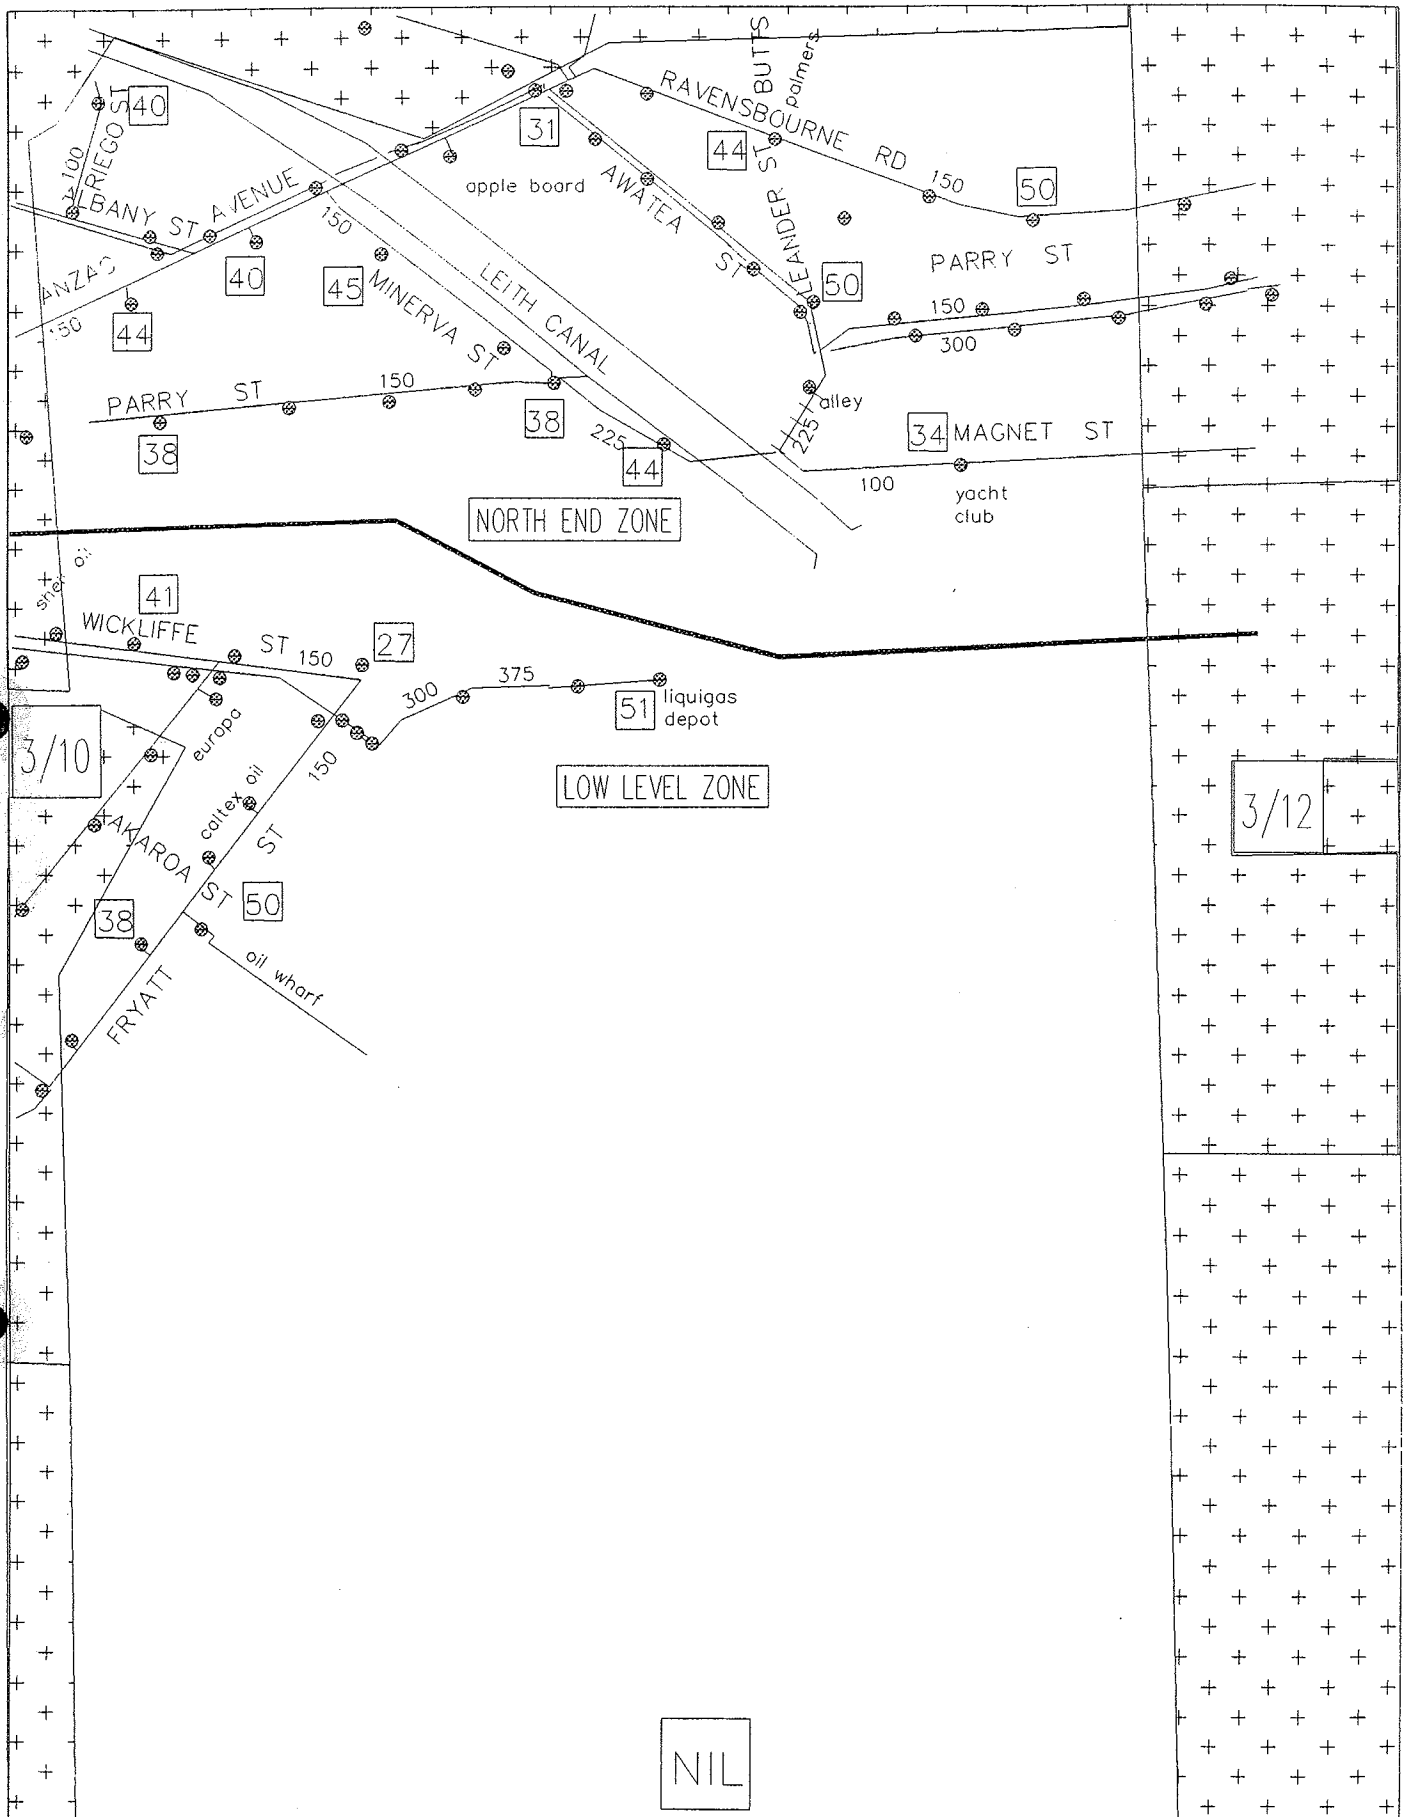

NIL

3/12

DATE OF ISSUE

PAGE CODE

3/11

NZ Fire Service District:6A01


Map Ref: 3/12

HYDRANTS AND MAINS CAPACITY DATA SHEET Mains Capacity at 100 kpa running pressure

Issue Date:

Monday, 29 November 1999

Location	No	Date	Size	Sp	Rp	Flow	Main Cap l/s
NORTH END ROWING CLUB		/12/91	100	600	150	20	22
PARRY STREET CNR RAVEN		/12/91	150	640	580	60	194
PARRY STREET O/S B.P.		/12/91	150	680	360	57	82
PARRY STREET O/S WOOLS		/12/91	150	660	380	60	91
RAVENSBOURNE ROAD O/S		/06/84	150	800	410	37	52
RAVENSBOURNE ROAD NO		/12/91	150	600	450	18	35

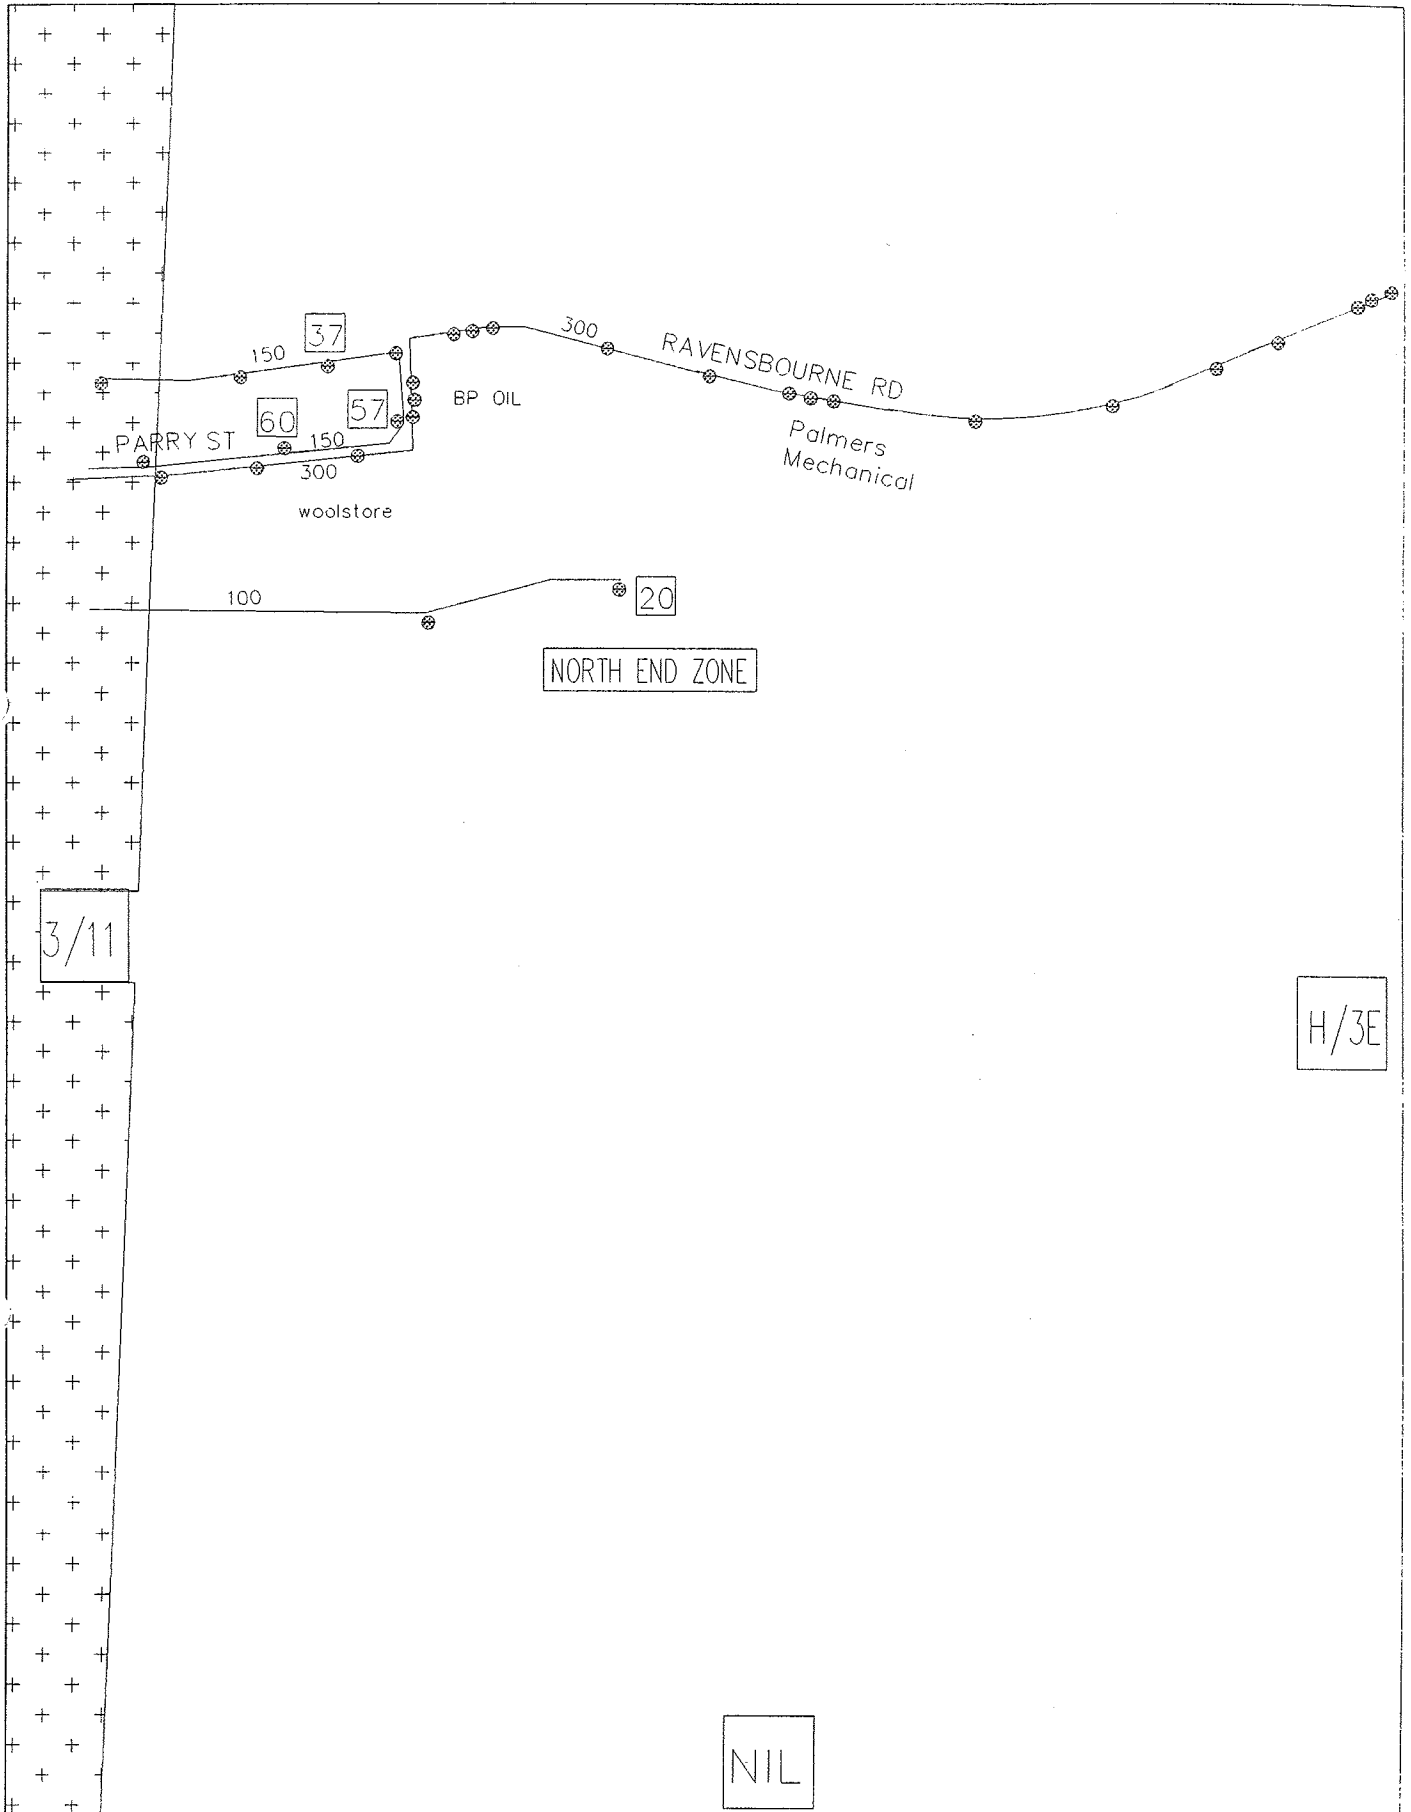

DATE OF ISSUE

PAGE CODE

3/12