



Appendix 1: Copy of Approved Plan
(Not to scale)

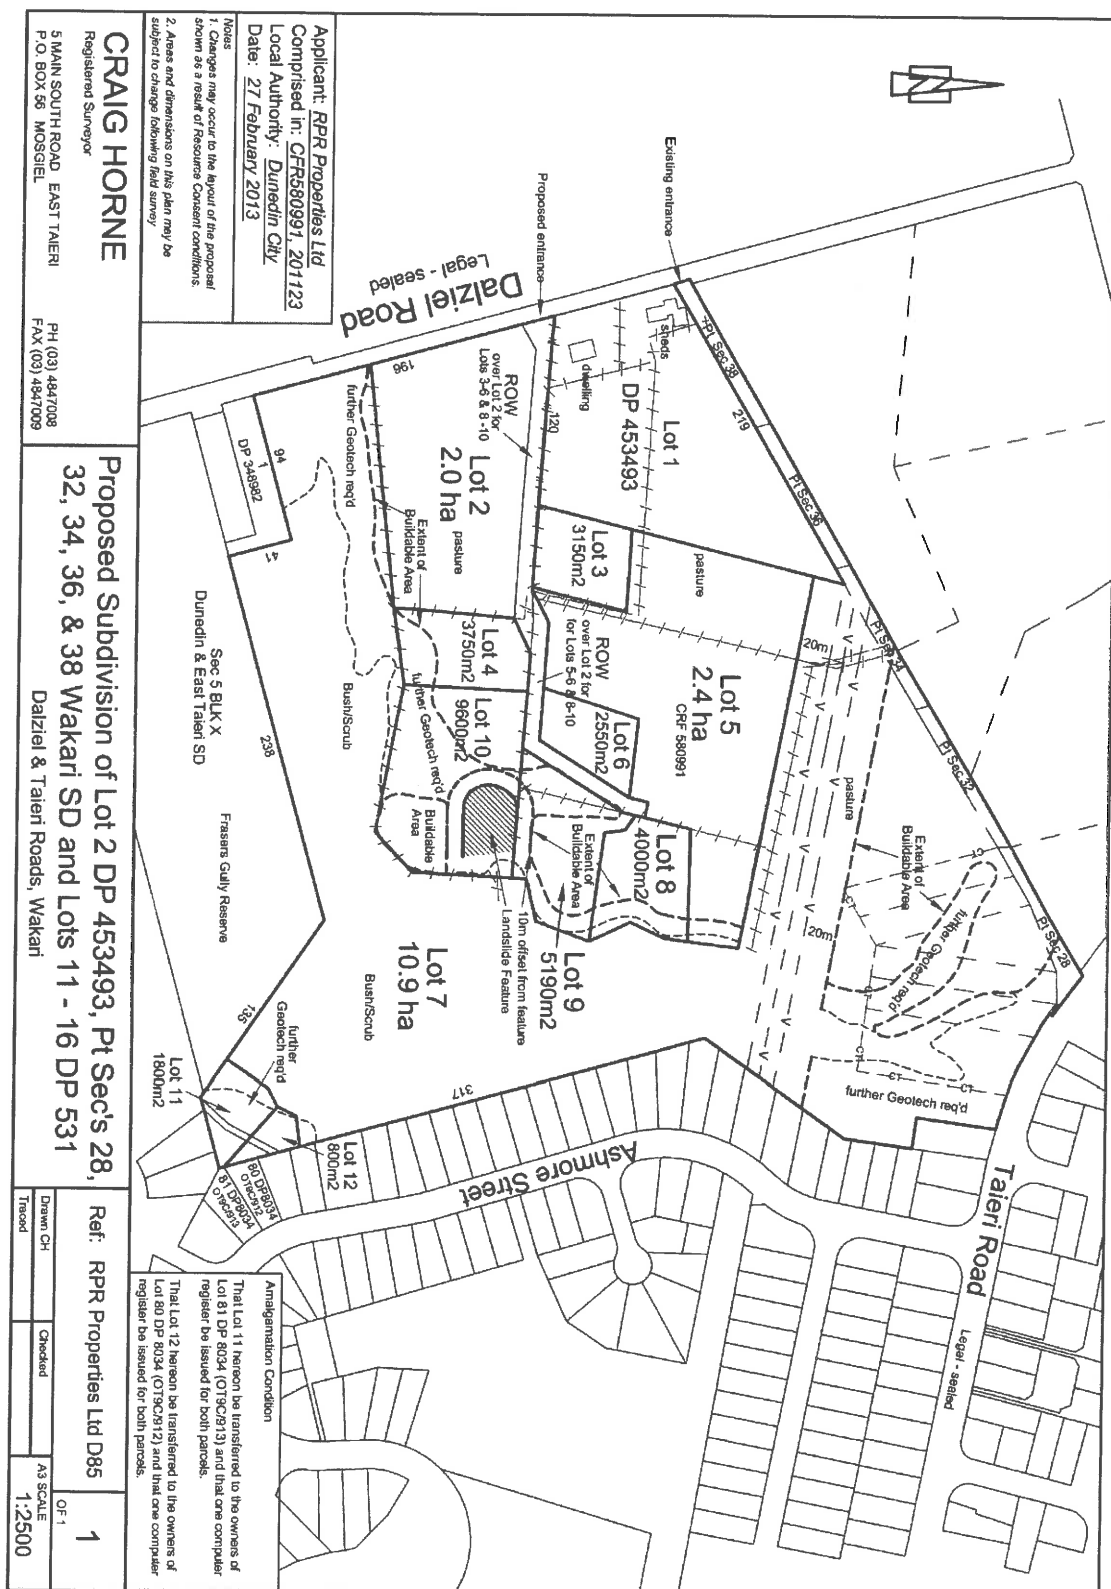

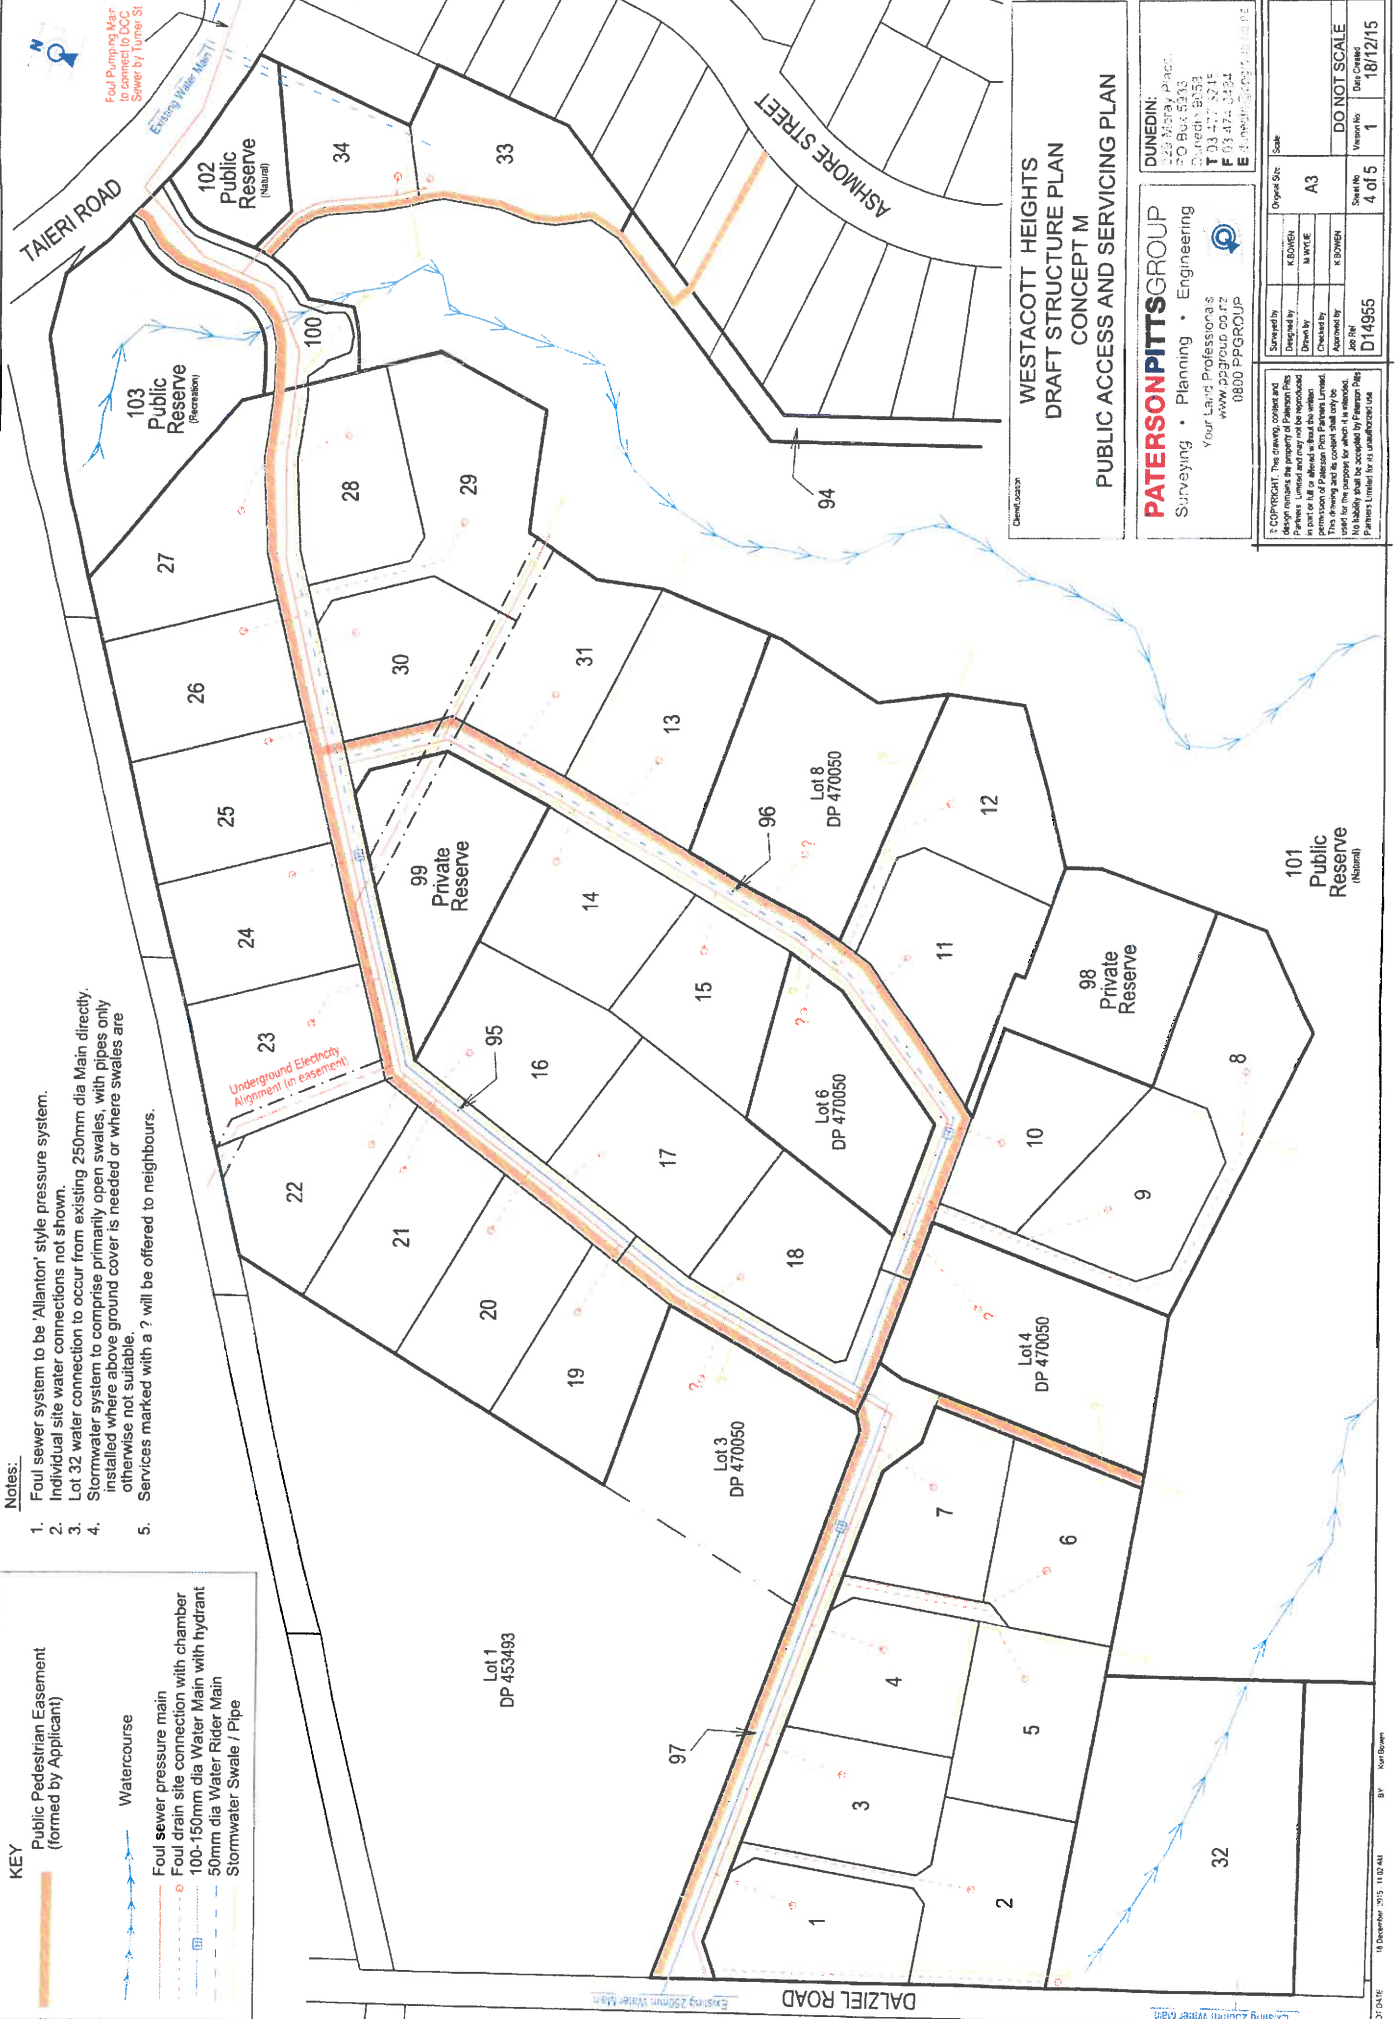

Notes:

1. Foul sewer system to be 'Allanton' style pressure system.
2. Individual site water connections not shown.
3. Lot 32 water connection to occur from existing 250mm dia Main directly.
4. Stormwater system to comprise primarily open swales, with pipes only installed where above ground cover is needed or where swales are otherwise not suitable.
5. Services marked with a ? will be offered to neighbours.

KEY	
	Public Pedestrian Easement (formed by Applicant)
	Watercourse
	Foul sewer pressure main
	Foul drain site connection with chamber
	100-150mm dia Water Main with hydrant
	50mm dia Water Rider Main
	Stormwater Swale / Pipe

WESTCOTT HEIGHTS
DRAFT STRUCTURE PLAN
CONCEPT M
PUBLIC ACCESS AND SERVICING PLAN

PATERSONPITTS GROUP
Surveying • Planning • Engineering
Your Land Professionals
www.ppgroup.co.nz
0800 PPGROUP

Scale	Original Size
Drawn by	K. BOWEN
Checked by	M. WYLLIE
Approved by	K. BOWEN
Job Ref	D14955
Version No	4 of 5
DO NOT SCALE	1
Date Created	18/12/15

THIS COPYRIGHT. This drawing, content and design remain the property of Paterson Pitts Group Limited and may not be reproduced or used in any form without the written permission of Paterson Pitts Group Limited. This drawing and its content shall only be used for the purpose for which it was created. No liability shall be accepted by Paterson Pitts Group Limited for its unauthorized use.