



GreenTrees Ltd

Peter Waymouth - Consulting Arborist
11 Bouverie St, Dunedin, NZ, 9010

p 03 473 8065
m 027 432 9646
e pw@greentrees.co.nz

21.08.24

Phillipa & Darren Bain
27 King Street,
Mosgiel 9024

Potential future effects of 'Clear to Sky' changes to Electricity Regulations 2003

Dear Phillipa & Darren,


Thank you for informing me about the Electricity Regulations 2003 which are expected to be Gazetted this September. The following photos have been overlaid to understand how these regulations may impact your tree should the local utility contractors be obliged to apply a blanket 'Clear to Sky' pruning policy within Dunedin. Until the new regulations come into force it will be unknown exactly how they may apply to your listed Pin Oak. In that respect, the illustrations below are purely speculative & of a hypothetical nature at this point in time.

If you require any further assistance or information please contact me.

Yours sincerely,

Peter Waymouth

Peter Waymouth

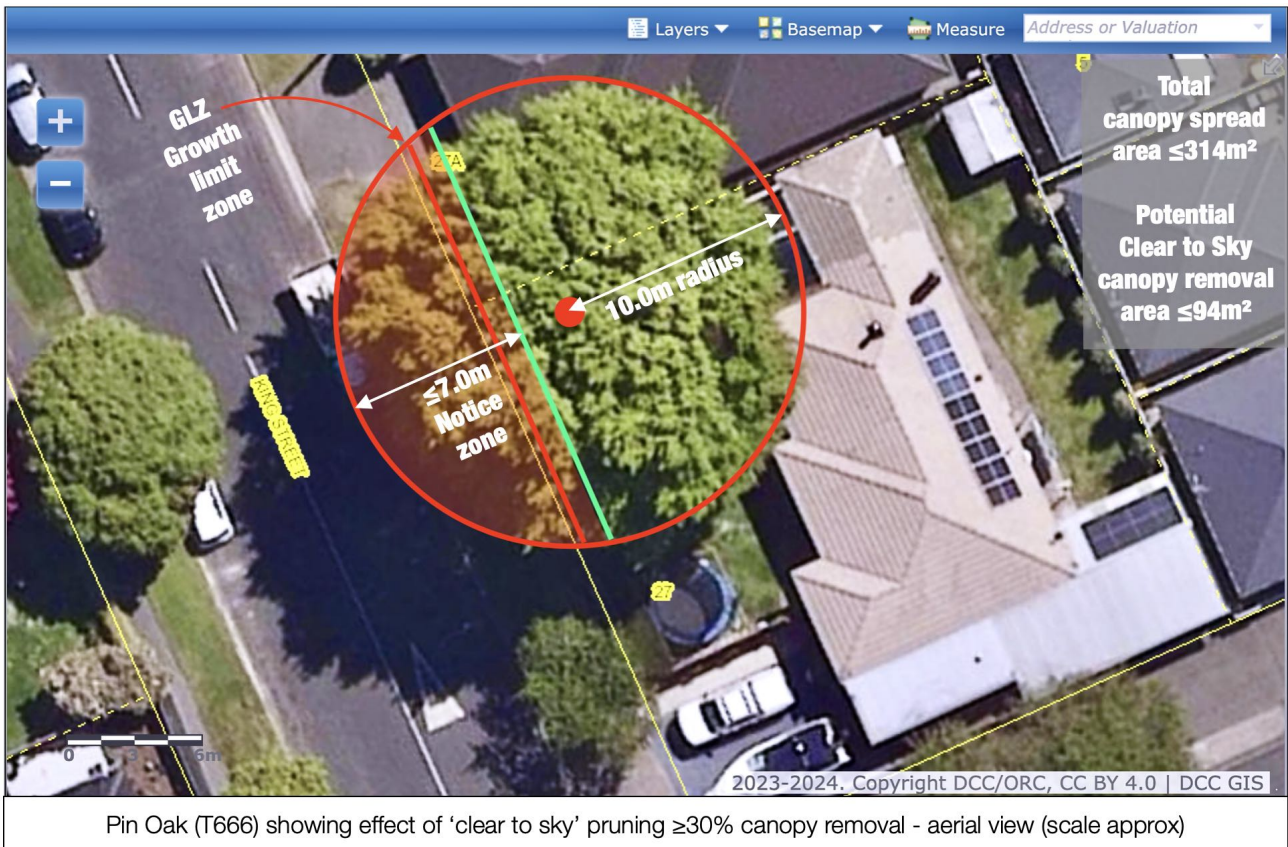




Pin Oak (T666) showing effect of 'clear to sky' pruning $\geq 30\%$ canopy removal - view Sth-Nth



Pin Oak (T666) showing effect of 'clear to sky' pruning $\geq 30\%$ canopy removal - view Nth-Sth

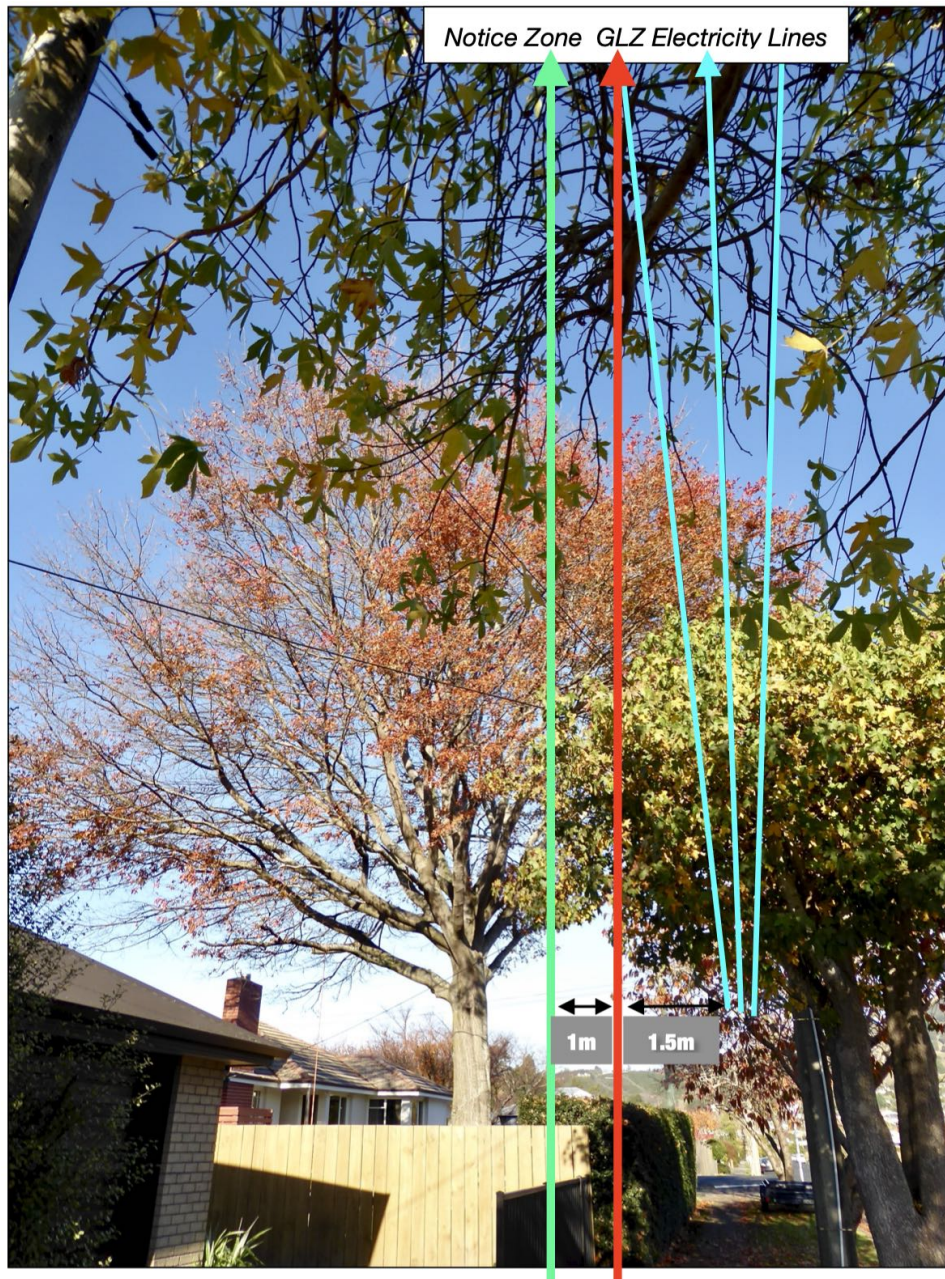

Red line represents the '*Clear to Sky*' pruning set back per the newly promulgated amendments to Growth Limit Zone (*GLZ*) & expected to be Gazetted in September 2024. Reference: Electricity (Hazards from Trees) Regulations 2003 & variations

N.B:

- A. The *GLZ* is set at 1.5m from the 400V low voltage (Blue) electricity lines shown above & the '*Notice Zone*' is also extended by 1.0m clearance from the electricity lines
- B. The Green, Red & Blue lines above are only indicative of the 3 dimensional plane being represented.