


OCTAGON CCTV CAMERAS

ELECTRICAL SERVICES


- E1.1 - CCTV Camera Positions
- E2.1 - Camera Cabling Setout & Equipment Details
- E2.2 - Camera Mounting Details
- E2.3 - Equipment Cabinet Locations

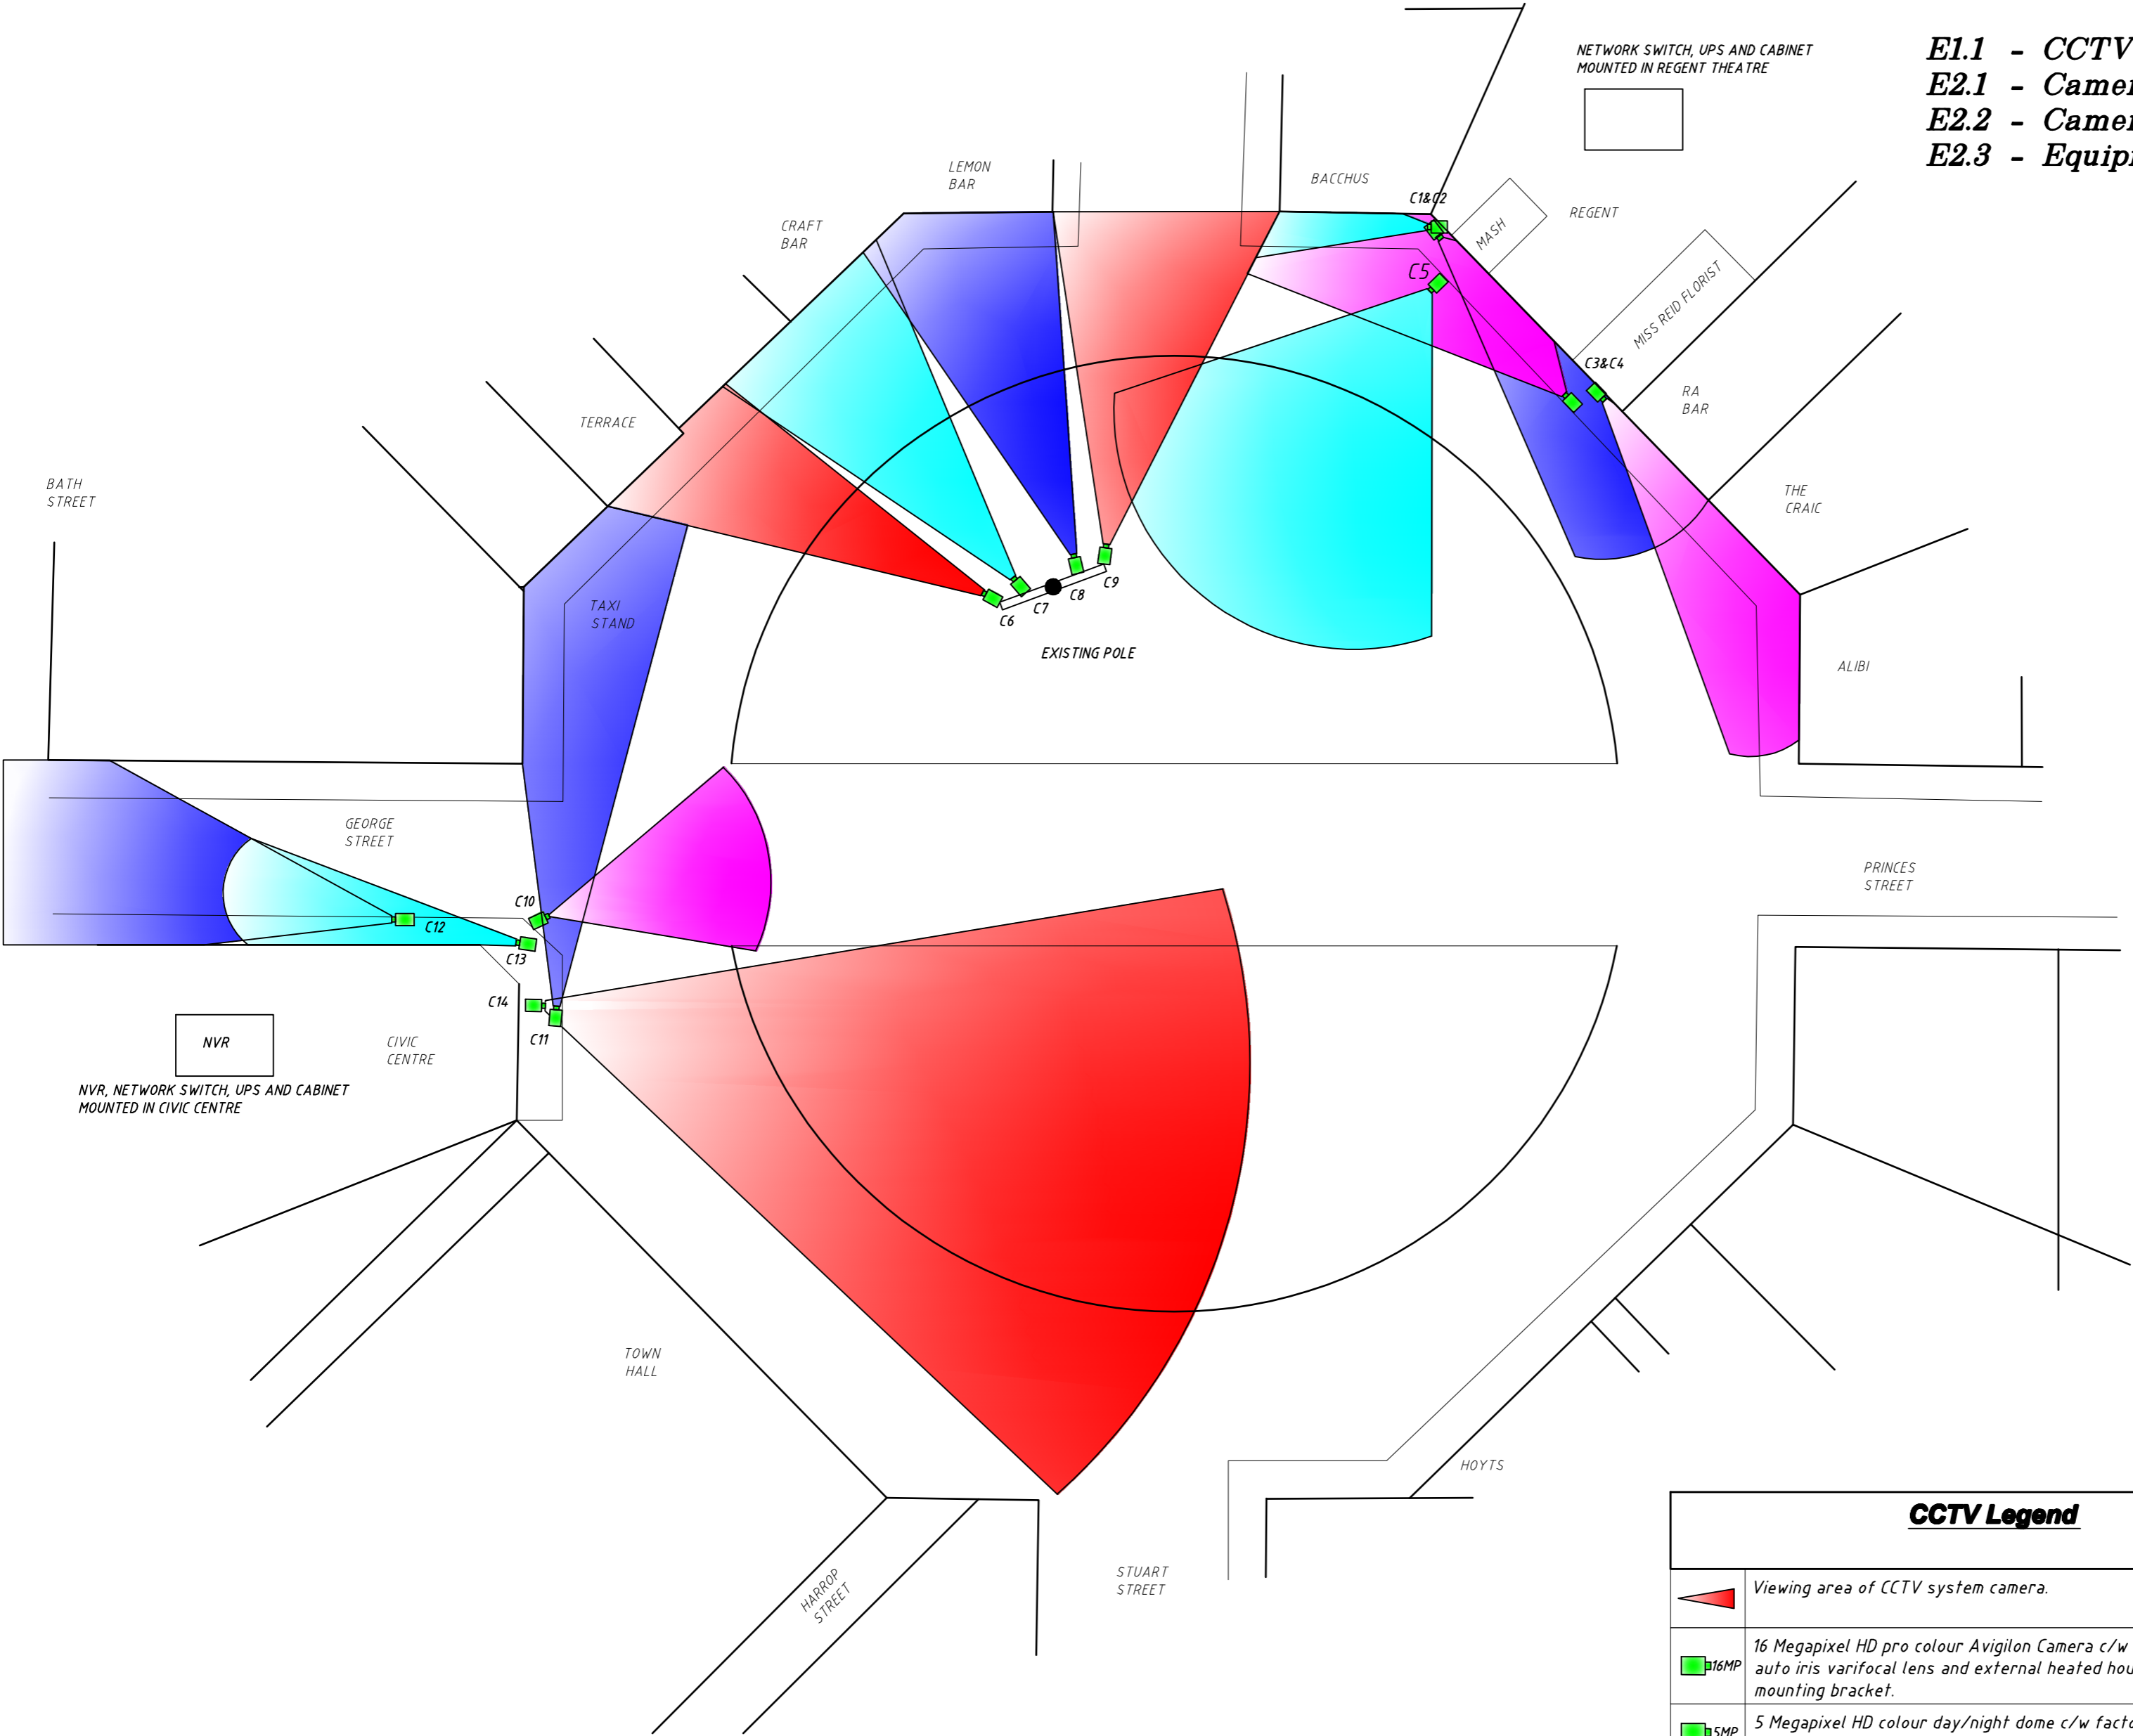

29 JAN 2010	3	TENDER
08 OCT 2009	2	FINAL REVIEW
10 MAR 2009	1	CONCEPT 2

**TENDER**

This document shall be read in conjunction with the specification



**DUNEDIN CITY COUNCIL**  
Kaunihera-a-rohe o Otepoti

**PEDERSEN READ**  
PROFESSIONAL ELECTRICAL ENGINEERS

First Floor, 121 Crawford Street, Dunedin  
Telephone +64 3 477 2333 - Facsimile +64 3 479 0523  
Email [dnooffice@pedersen.co.nz](mailto:dnooffice@pedersen.co.nz)

Client:  
DUNEDIN CITY COUNCIL

Architect:

Mechanical Engineer:

Structural Engineer:

Project:  
**OCTAGON CCTV CAMERAS**

Dwg Title:  
**ELECTRICAL SERVICES  
CCTV CAMERA POSITIONS**

Xrefs Attached: x-site x-plan	File Name: <b>1878e-elect</b>	Scale at A2: <b>NTS</b>
	Date Printed:	Job No: <b>1878</b>
	Sheet No.: <b>E1.1</b>	Revision: <b>3</b>